

Floodlight Summary:

Report based on lamp delivering 1000 lumens.

Maximum Intensity	11680.0 cd per klm.
(Luminaire orientation as tested.)	0.0 degrees vertical
	0.0 degrees horizontal

Beam Spread	At 10% of Imax	26.0V x 26.2H
	At 50% of Imax	13.8V x 13.7H
	At 90% of Imax	6.1V x 5.9H

Beam Flux	Total	1000.6 lumens per klm.
	To 10% of Imax	738.0 lumens per klm.
	To 50% of Imax	416.9 lumens per klm.
	To 90% of Imax	129.9 lumens per klm.

Upward LOR	2.2 %
Downward LOR	97.8 %


Luminaire Efficiency(Light Output Ratio)	100.0 %
--	---------

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-10-18

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

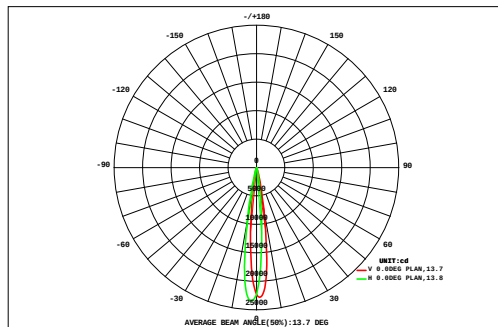

DATA OF LAMP		Eff:102.21lm/W	
MODEL		Imax(cd)	23395
NOMINAL POWER(W)	19.6	AVAILABILITY(%)	73.8
RATED VOLTAGE(V)	220	Avai. FLUX(lm)	1479
NOMINAL FLUX(lm)	2003	LOR(%)	100.0
LAMPS INSIDE	1	TOTAL FLUX(lm)	2003
TEST VOLTAGE(V)	220	q @50%(H,V)	14,14DEG

VERTICAL (DEG)	AREA FLUX DIAGRAM																UNIT:lm				F t	F a
	18	16	14	12	10	8	6	4	2	0	2	4	6	8	10	12	14	16	18			
	0.40	0.45	0.51	0.57	0.64	0.71	0.78	0.83	0.86	0.87	0.86	0.82	0.75	0.68	0.61	0.54	0.47	0.41	11.7	0.00		
	0.45	0.51	0.59	0.69	0.80	0.92	1.03	1.14	1.20	1.22	1.19	1.11	1.01	0.88	0.75	0.64	0.55	0.47	15.1	0.00		
	0.50	0.59	0.70	0.85	1.02	1.24	1.48	1.67	1.77	1.81	1.79	1.63	1.39	1.17	0.97	0.78	0.64	0.53	20.5	0.00		
	0.56	0.67	0.84	1.06	1.38	1.78	2.18	2.56	2.79	2.90	2.85	2.53	2.10	1.64	1.28	0.98	0.77	0.61	29.5	6.28		
	0.62	0.77	1.00	1.37	1.87	2.54	3.44	4.20	4.62	4.83	4.75	4.15	3.19	2.36	1.70	1.25	0.93	0.72	44.3	28.6		
	0.70	0.90	1.23	1.72	2.51	3.74	5.24	6.70	7.71	8.16	7.83	6.57	4.87	3.35	2.28	1.63	1.19	0.87	67.2	54.2		
	0.77	1.04	1.49	2.19	3.34	5.14	7.69	10.7	12.7	13.7	12.9	10.0	7.04	4.80	3.33	2.26	1.54	1.06	102	89.9		
	0.84	1.17	1.75	2.76	4.41	6.96	10.7	15.3	18.8	20.3	18.7	14.5	10.7	7.45	4.83	3.03	1.92	1.25	145	137		
	0.89	1.27	1.94	3.22	5.34	8.81	14.0	19.4	23.9	25.9	24.1	20.7	15.6	10.3	6.33	3.75	2.26	1.41	189	181		
	0.93	1.38	2.21	3.80	6.55	11.1	17.7	24.3	27.8	28.1	27.4	24.1	18.3	12.0	7.18	4.16	2.44	1.49	221	213		
	0.97	1.48	2.46	4.29	7.59	13.1	20.0	25.2	27.7	28.2	27.1	23.9	18.2	11.9	7.10	4.13	2.40	1.46	227	220		
	0.95	1.46	2.41	4.24	7.28	11.9	17.3	22.0	25.2	26.0	24.5	20.9	15.8	10.5	6.36	3.78	2.19	1.35	204	196		
	0.89	1.34	2.15	3.62	5.80	8.96	12.9	17.1	20.3	21.1	19.5	16.1	11.9	8.07	5.14	3.15	1.88	1.19	161	153		
	0.79	1.16	1.74	2.68	4.19	6.23	8.78	11.7	14.1	14.7	13.3	11.0	8.19	5.64	3.75	2.36	1.53	1.01	113	103		
	0.66	0.94	1.35	1.95	2.84	4.05	5.60	7.31	8.66	9.00	8.21	6.82	5.20	3.73	2.55	1.73	1.18	0.82	72.6	60.9		
	0.53	0.74	1.02	1.41	1.92	2.59	3.46	4.34	5.04	5.20	4.77	4.04	3.16	2.37	1.73	1.25	0.89	0.63	45.1	30.8		
	0.42	0.56	0.75	1.01	1.33	1.69	2.10	2.52	2.86	2.93	2.71	2.35	1.94	1.56	1.19	0.88	0.65	0.48	27.9	5.62		
	0.32	0.42	0.55	0.70	0.89	1.12	1.34	1.53	1.66	1.69	1.61	1.45	1.25	1.01	0.80	0.62	0.47	0.36	17.8	0.00		
-18	-16	-14	-12	-10	-8	-6	-4	HORIZONTAL (DEG)				4	6	8	10	12	14	16	18			
F t	12.2	16.9	24.7	38.1	59.7	92.6	136	178	208	217	204	173	131	89.4	57.9	36.9	23.9	16.1	1714	---		
F a	0.00	0.00	1.41	20.9	46.1	81.5	126	170	200	208	196	163	121	77.7	44.1	21.4	1.38	0.00	---		1479	

one-half-peak spread: U:6.7,D:7.1 , L:7.0,R:6.8


NEMA Beam Type: Type 2

H_(b) Range: -90 - 90DEG
 H_(b) Interval: 0.5DEG
 Test Speed: LOW
 Temperature: 25.3DEG
 Operators: Fan
 Test Date: 2023-10-18

V(B) Range: -180 - 180DEG
 V(B) Interval: 0.5DEG
 Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351
 Humidity: 65.0%
 Test Distance: 8.630m [K=1.0000]
 Remarks:

ISOCANDELA DIAGRAM

NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

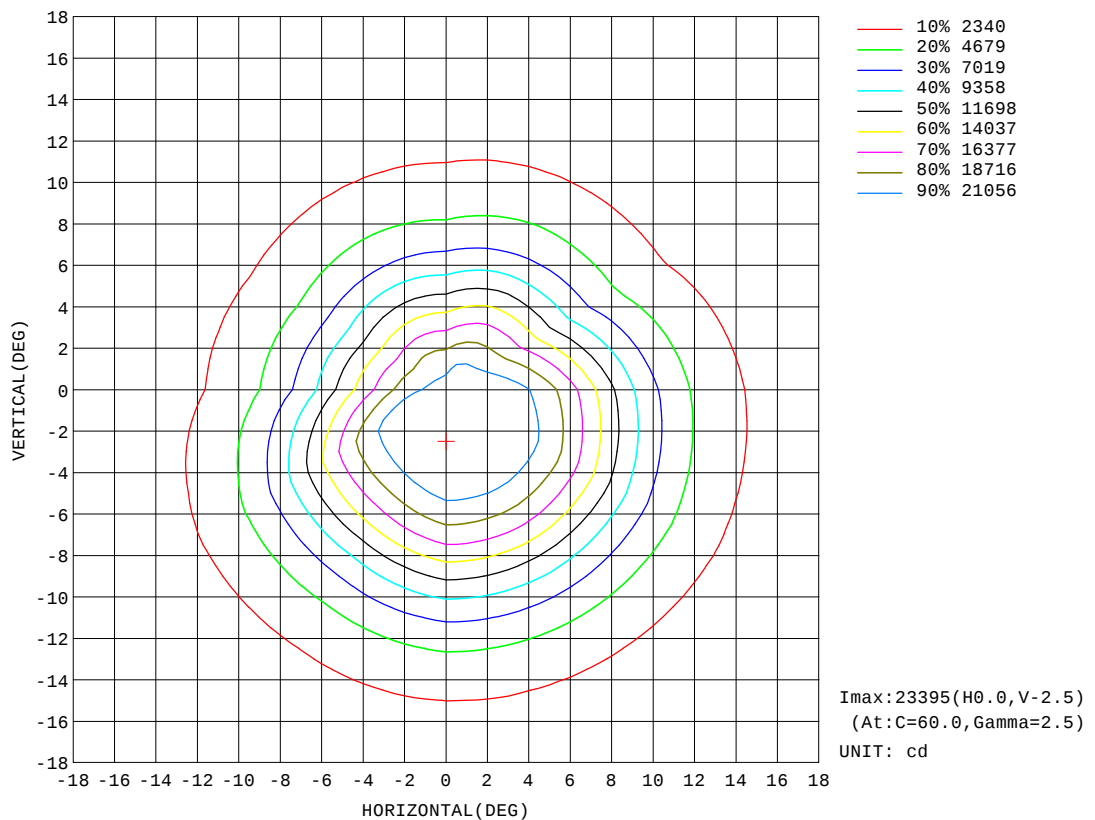


H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-10-18

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

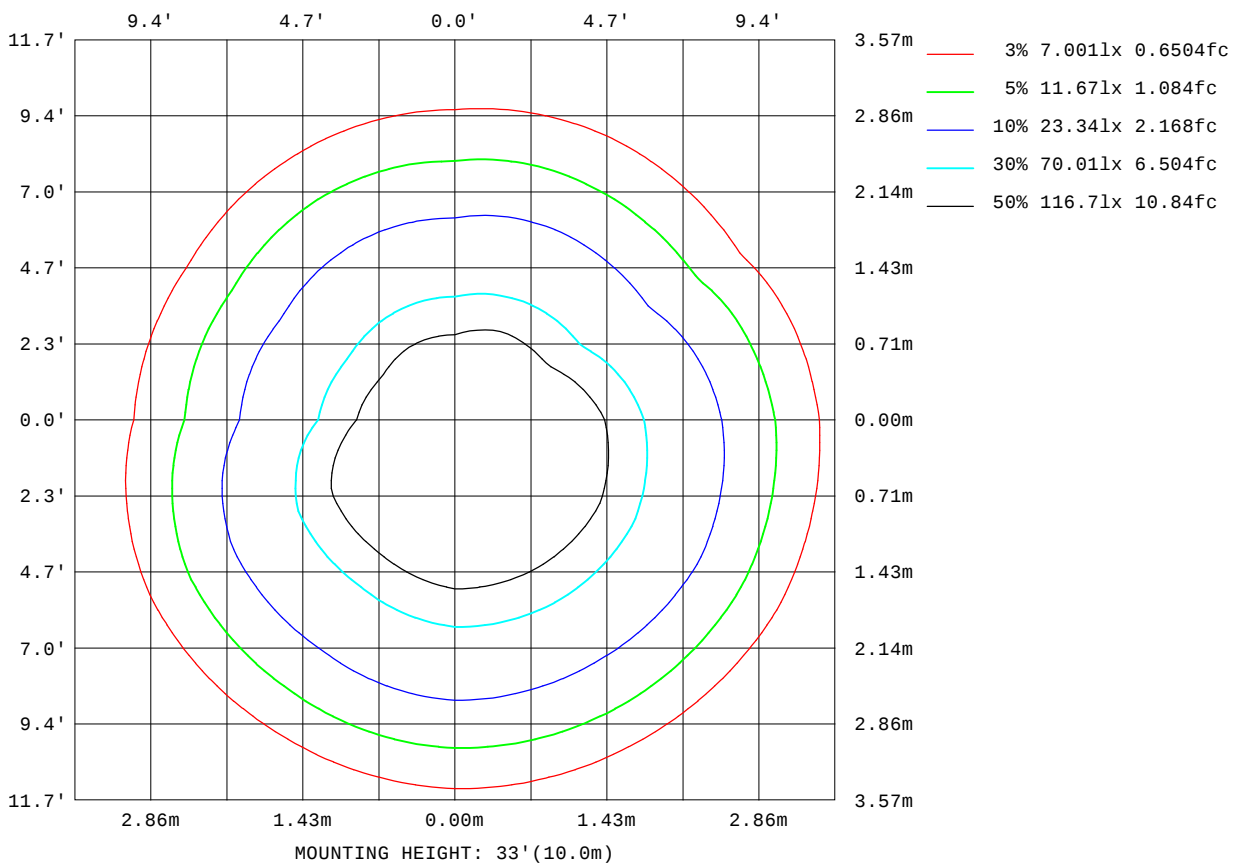

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-10-18

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

Planar Illuminance Curve

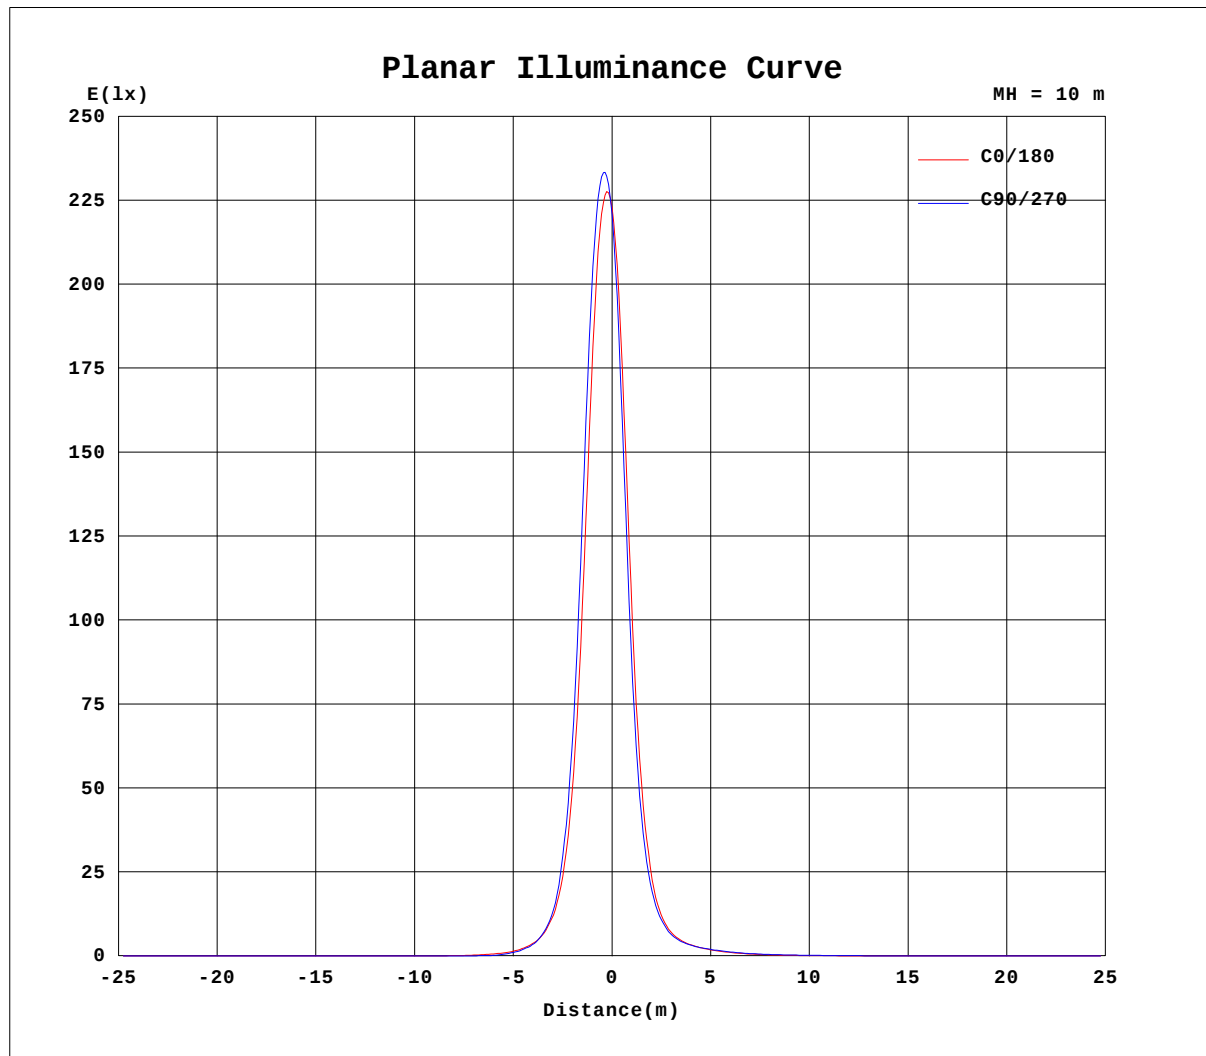


H_(b) Range: -90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature: 25.3DEG
Operators: Fan
Test Date: 2023-10-18

V(B) Range: -180 - 180DEG
V(B) Interval: 0.5DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity: 65.0%
Test Distance: 8.630m [K=1.0000]
Remarks:

AAI CURVES

NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

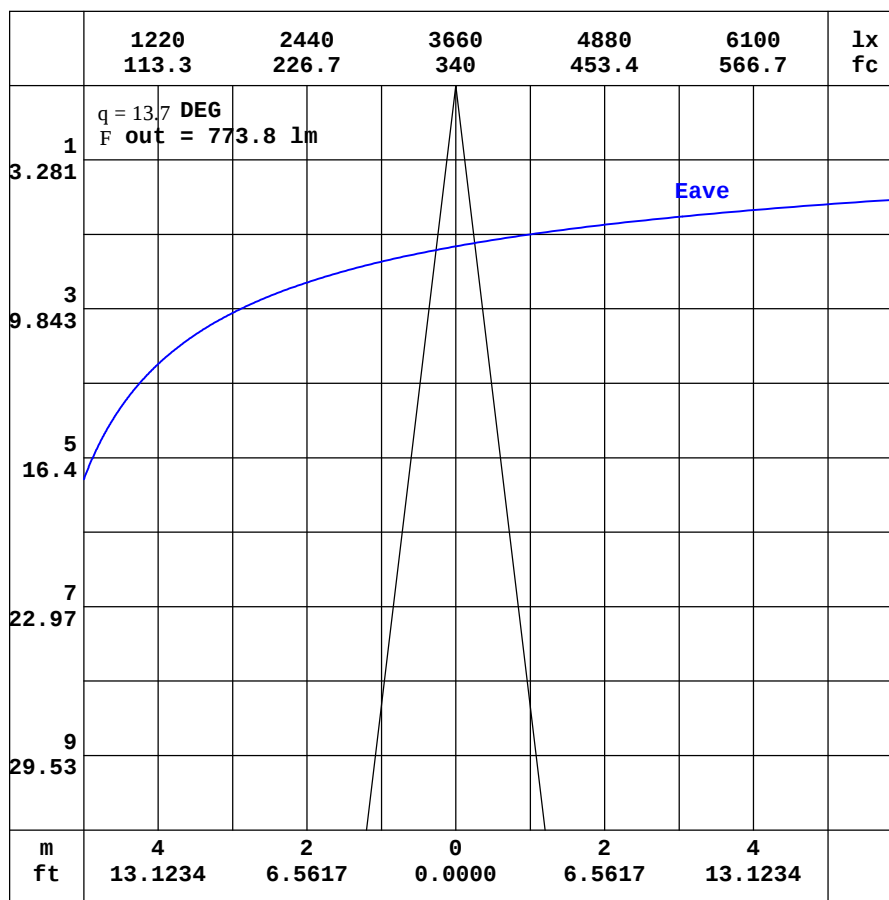

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

$H(b)$ Range:-90 - 90DEG
 $H(b)$ Interval: 0.5DEG
 Test Speed: LOW
 Temperature:25.3DEG
 Operators:Fan
 Test Date:2023-10-18

$V(B)$ Range:-180 - 180DEG
 $V(B)$ Interval: 0.5DEG
 Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
 Humidity:65.0%
 Test Distance:8.630m [K=1.0000]
 Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

Table--1

UNIT: ×10cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-180	0.69	0.49	0.44	0.45	0.45	0.45	0.51	0.69	1.06	1.46	1.67	1.74	1.70	1.59	1.57	1.57	1.44	1.15	1.06
-170	0.69	0.49	0.44	0.45	0.44	0.43	0.44	0.53	0.76	1.02	1.16	1.22	1.24	1.27	1.34	1.45	1.52	1.56	1.57
-160	0.69	0.49	0.44	0.45	0.44	0.42	0.39	0.38	0.46	0.56	0.62	0.63	0.66	0.85	1.04	1.20	1.32	1.39	1.41
-150	0.69	0.50	0.44	0.44	0.44	0.42	0.37	0.30	0.25	0.22	0.18	0.27	0.40	0.53	0.66	0.78	0.86	0.91	0.92
-140	0.69	0.51	0.44	0.44	0.44	0.42	0.39	0.31	0.21	0.14	0.13	0.14	0.18	0.24	0.30	0.36	0.41	0.43	0.44
-130	0.69	0.52	0.45	0.43	0.43	0.43	0.41	0.38	0.32	0.26	0.20	0.16	0.14	0.13	0.14	0.14	0.15	0.15	0.16
-120	0.69	0.54	0.46	0.43	0.43	0.43	0.42	0.42	0.41	0.39	0.36	0.33	0.30	0.27	0.24	0.23	0.21	0.21	0.21
-110	0.69	0.57	0.49	0.45	0.43	0.42	0.42	0.42	0.42	0.42	0.42	0.42	0.42	0.42	0.42	0.41	0.41	0.41	0.41
-100	0.69	0.60	0.52	0.47	0.43	0.41	0.40	0.40	0.41	0.41	0.41	0.42	0.42	0.42	0.42	0.43	0.43	0.43	0.43
-90	0.69	0.63	0.57	0.51	0.44	0.38	0.32	0.32	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33	0.33
-80	0.69	0.66	0.60	0.53	0.44	0.33	0.21	0.18	0.17	0.15	0.14	0.13	0.12	0.12	0.11	0.11	0.10	0.10	0.10
-70	0.69	0.68	0.64	0.55	0.43	0.29	0.14	0.08	0.07	0.06	0.06	0.06	0.05	0.05	0.05	0.05	0.05	0.05	0.05
-60	0.69	0.71	0.67	0.57	0.45	0.31	0.17	0.06	0.06	0.07	0.07	0.06	0.05	0.05	0.05	0.05	0.05	0.05	0.05
-50	0.69	0.74	0.70	0.61	0.50	0.39	0.27	0.15	0.09	0.09	0.09	0.10	0.10	0.09	0.09	0.09	0.09	0.08	0.07
-40	0.69	0.77	0.74	0.66	0.59	0.51	0.45	0.37	0.22	0.15	0.17	0.19	0.21	0.23	0.23	0.25	0.28	0.29	0.26
-30	0.69	0.79	0.78	0.74	0.70	0.69	0.72	0.72	0.66	0.50	0.28	0.40	0.70	1.15	1.77	2.45	3.58	4.94	5.27
-20	0.69	0.82	0.83	0.82	0.83	0.91	1.08	1.21	1.30	1.43	1.62	2.04	2.73	6.38	12.3	22.2	37.2	55.9	66.8
-10	0.69	0.84	0.88	0.91	0.97	1.16	1.46	1.76	2.15	2.86	4.05	6.36	11.3	19.1	38.0	88.3	233	582	963
0	0.69	0.86	0.93	1.00	1.10	1.38	1.82	2.30	3.02	4.36	6.51	11.2	18.9	30.4	50.8	109	364	1252	2228
10	0.69	0.86	0.93	1.00	1.10	1.37	1.80	2.29	3.04	4.39	6.54	10.4	17.0	26.5	39.2	61.2	116	219	293
20	0.69	0.86	0.93	1.00	1.09	1.31	1.69	2.13	2.77	3.88	5.57	8.03	11.8	17.5	24.5	31.9	39.2	45.8	48.5
30	0.69	0.86	0.93	0.99	1.07	1.21	1.50	1.87	2.33	3.04	4.17	5.71	7.64	9.94	12.8	15.8	18.5	20.4	21.1
40	0.69	0.84	0.93	0.98	1.05	1.14	1.30	1.57	1.88	2.27	2.87	3.67	4.68	5.86	7.08	7.97	8.75	9.25	9.45
50	0.69	0.83	0.92	0.97	1.02	1.08	1.16	1.29	1.47	1.70	1.97	2.30	2.70	3.20	3.63	3.99	4.33	4.56	4.66
60	0.69	0.81	0.90	0.96	0.99	1.04	1.09	1.15	1.21	1.29	1.40	1.53	1.66	1.79	1.92	2.02	2.11	2.18	2.21
70	0.69	0.78	0.86	0.92	0.97	1.01	1.04	1.07	1.10	1.14	1.17	1.21	1.25	1.28	1.30	1.32	1.34	1.35	1.36
80	0.69	0.74	0.80	0.85	0.90	0.94	0.98	1.01	1.04	1.06	1.08	1.09	1.11	1.12	1.12	1.13	1.13	1.14	1.14
90	0.69	0.70	0.72	0.74	0.76	0.78	0.80	0.81	0.83	0.85	0.86	0.88	0.90	0.90	0.90	0.90	0.91	0.91	0.91
100	0.69	0.66	0.64	0.62	0.61	0.60	0.59	0.58	0.58	0.58	0.58	0.59	0.60	0.59	0.59	0.59	0.60	0.60	0.60
110	0.69	0.62	0.57	0.54	0.52	0.51	0.51	0.51	0.52	0.52	0.53	0.53	0.54	0.53	0.53	0.53	0.53	0.53	0.53
120	0.69	0.59	0.52	0.49	0.48	0.49	0.48	0.48	0.47	0.47	0.47	0.47	0.47	0.48	0.48	0.49	0.49	0.50	0.50
130	0.69	0.56	0.49	0.47	0.47	0.47	0.46	0.45	0.45	0.47	0.50	0.55	0.63	0.73	0.83	0.93	1.00	1.05	1.07
140	0.69	0.53	0.47	0.46	0.47	0.45	0.45	0.45	0.50	0.59	0.75	0.98	1.21	1.40	1.52	1.60	1.64	1.66	1.67
150	0.69	0.52	0.46	0.46	0.46	0.45	0.45	0.51	0.64	0.90	1.22	1.49	1.64	1.72	1.76	1.79	1.80	1.81	1.82
160	0.69	0.51	0.45	0.46	0.45	0.45	0.48	0.58	0.84	1.22	1.53	1.69	1.76	1.80	1.84	1.89	1.94	1.97	1.99
170	0.69	0.50	0.45	0.46	0.45	0.45	0.50	0.66	1.01	1.41	1.65	1.74	1.77	1.77	1.82	1.87	1.83	1.72	1.72
180	0.69	0.49	0.44	0.45	0.45	0.45	0.51	0.69	1.06	1.46	1.67	1.74	1.70	1.59	1.57	1.57	1.44	1.15	1.06

H_b Range: -90 - 90DEGH_b Interval: 0.5DEG

Test Speed: LOW

Temperature: 25.3DEG

Operators: Fan

Test Date: 2023-10-18

V(B) Range: -180 - 180DEG

V(B) Interval: 0.5DEG

Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351

Humidity: 65.0%

Test Distance: 8.630m [K=1.0000]

Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:Nuit 100-100mm-3000K-14D-Rev1	TYPE:3000K	WEIGHT:
SPEC.:14 DEG	DIM.:100MM	SERIAL No.:IES001924
MFR.:	SUR.:	Shielding Angle:

Table--2

UNIT: ×10cd

H(°) \ V(°)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-180	1.15	1.26	1.23	1.12	1.00	0.86	0.64	0.42	0.25	0.14	0.13	0.20	0.32	0.41	0.43	0.42	0.39	0.31
-170	1.55	1.49	1.41	1.23	1.02	0.81	0.59	0.38	0.22	0.14	0.14	0.21	0.33	0.41	0.43	0.42	0.39	0.31
-160	1.38	1.30	1.17	1.00	0.82	0.62	0.43	0.27	0.17	0.13	0.16	0.25	0.36	0.42	0.43	0.42	0.39	0.31
-150	0.90	0.84	0.75	0.64	0.50	0.37	0.25	0.17	0.13	0.14	0.21	0.31	0.39	0.42	0.42	0.41	0.38	0.31
-140	0.43	0.40	0.35	0.29	0.22	0.17	0.14	0.13	0.16	0.22	0.30	0.38	0.42	0.43	0.42	0.41	0.38	0.31
-130	0.15	0.15	0.14	0.14	0.14	0.15	0.17	0.22	0.28	0.34	0.39	0.42	0.42	0.42	0.42	0.40	0.37	0.31
-120	0.21	0.22	0.23	0.25	0.28	0.31	0.35	0.38	0.40	0.42	0.42	0.42	0.42	0.42	0.41	0.39	0.36	0.31
-110	0.41	0.41	0.42	0.42	0.42	0.43	0.43	0.43	0.43	0.42	0.42	0.42	0.42	0.41	0.40	0.39	0.37	0.35
-100	0.43	0.43	0.43	0.42	0.42	0.42	0.42	0.41	0.41	0.40	0.40	0.39	0.38	0.37	0.36	0.35	0.33	0.31
-90	0.32	0.32	0.32	0.32	0.32	0.32	0.32	0.31	0.31	0.31	0.31	0.31	0.31	0.31	0.31	0.31	0.31	0.31
-80	0.10	0.10	0.10	0.11	0.11	0.12	0.12	0.13	0.14	0.15	0.17	0.18	0.20	0.22	0.25	0.27	0.29	0.31
-70	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.06	0.06	0.07	0.08	0.09	0.12	0.15	0.18	0.23	0.27	0.31
-60	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.05	0.07	0.08	0.10	0.14	0.19	0.25	0.31
-50	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.07	0.05	0.05	0.07	0.08	0.09	0.11	0.15	0.23	0.31
-40	0.26	0.24	0.22	0.19	0.18	0.16	0.14	0.12	0.10	0.09	0.09	0.08	0.08	0.09	0.10	0.13	0.22	0.31
-30	4.77	3.20	2.25	1.46	0.88	0.49	0.28	0.23	0.19	0.15	0.13	0.11	0.10	0.10	0.10	0.12	0.20	0.31
-20	58.6	40.2	24.4	13.1	6.03	2.29	1.13	0.54	0.33	0.23	0.18	0.15	0.12	0.11	0.10	0.12	0.19	0.31
-10	720	317	114	44.6	18.5	8.00	3.24	1.36	0.61	0.31	0.24	0.19	0.14	0.12	0.11	0.11	0.19	0.31
0	1942	746	202	66.4	26.8	11.8	5.39	2.08	0.90	0.40	0.28	0.22	0.16	0.13	0.11	0.11	0.19	0.31
10	264	140	71.0	41.8	24.8	14.1	7.44	3.84	2.07	1.15	0.76	0.53	0.36	0.25	0.19	0.16	0.21	0.31
20	46.9	40.4	32.8	24.9	17.9	11.9	7.23	4.33	2.62	1.63	1.11	0.77	0.52	0.36	0.27	0.22	0.24	0.31
30	20.6	18.8	16.1	12.9	9.83	7.28	5.36	3.87	2.60	1.81	1.31	0.91	0.62	0.45	0.34	0.27	0.26	0.31
40	9.18	8.57	7.74	6.80	5.55	4.43	3.45	2.71	2.22	1.80	1.31	0.93	0.69	0.53	0.40	0.32	0.29	0.31
50	4.50	4.23	3.88	3.47	3.01	2.59	2.23	1.95	1.69	1.45	1.19	0.92	0.74	0.58	0.45	0.36	0.32	0.31
60	2.17	2.09	2.00	1.90	1.78	1.65	1.51	1.37	1.25	1.15	1.08	0.94	0.77	0.62	0.50	0.41	0.34	0.31
70	1.34	1.33	1.30	1.27	1.24	1.20	1.16	1.12	1.08	1.05	1.01	0.94	0.80	0.66	0.54	0.44	0.36	0.31
80	1.13	1.12	1.11	1.10	1.08	1.07	1.05	1.03	1.01	0.99	0.97	0.93	0.80	0.67	0.56	0.46	0.38	0.31
90	0.91	0.90	0.90	0.90	0.89	0.89	0.87	0.85	0.83	0.81	0.79	0.77	0.70	0.62	0.54	0.47	0.39	0.31
100	0.59	0.58	0.58	0.57	0.56	0.56	0.55	0.54	0.54	0.54	0.54	0.55	0.54	0.53	0.50	0.46	0.40	0.31
110	0.52	0.51	0.51	0.51	0.50	0.50	0.49	0.49	0.48	0.46	0.45	0.45	0.46	0.46	0.46	0.45	0.40	0.31
120	0.50	0.49	0.48	0.47	0.45	0.44	0.44	0.45	0.45	0.46	0.45	0.44	0.44	0.44	0.44	0.44	0.40	0.31
130	1.04	0.98	0.89	0.79	0.69	0.59	0.53	0.48	0.45	0.44	0.44	0.44	0.44	0.43	0.43	0.43	0.40	0.31
140	1.66	1.63	1.58	1.48	1.35	1.14	0.91	0.70	0.56	0.46	0.42	0.42	0.44	0.43	0.43	0.43	0.40	0.31
150	1.81	1.80	1.77	1.74	1.69	1.60	1.42	1.14	0.74	0.48	0.39	0.38	0.42	0.43	0.43	0.42	0.40	0.31
160	1.97	1.94	1.88	1.82	1.78	1.74	1.50	1.16	0.78	0.47	0.33	0.33	0.38	0.43	0.43	0.42	0.40	0.31
170	1.79	1.87	1.90	1.76	1.55	1.35	1.12	0.86	0.59	0.36	0.25	0.26	0.35	0.42	0.43	0.42	0.39	0.31
180	1.15	1.26	1.23	1.12	1.00	0.86	0.64	0.42	0.25	0.14	0.13	0.20	0.32	0.41	0.43	0.42	0.39	0.31

H_(b) Range: -90 - 90DEGH_(b) Interval: 0.5DEG

Test Speed: LOW

Temperature: 25.3DEG

Operators: Fan

Test Date: 2023-10-18

V(B) Range: -180 - 180DEG

V(B) Interval: 0.5DEG

Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351

Humidity: 65.0%

Test Distance: 8.630m [K=1.0000]

Remarks: