

Floodlight Summary:

Report based on lamp delivering 1000 lumens.

Maximum Intensity	1757.4 cd per klm.
(Luminaire orientation as tested.)	0.0 degrees vertical
	0.0 degrees horizontal

Beam Spread	At 10% of Imax	71.2V x 73.0H
	At 50% of Imax	42.1V x 41.8H
	At 90% of Imax	17.4V x 17.9H

Beam Flux	Total	1000.3 lumens per klm.
	To 10% of Imax	876.3 lumens per klm.
	To 50% of Imax	537.5 lumens per klm.
	To 90% of Imax	127.6 lumens per klm.

Upward LOR	2.0 %
Downward LOR	98.0 %


Luminaire Efficiency(Light Output Ratio)	100.0 %
--	---------

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-07-31

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

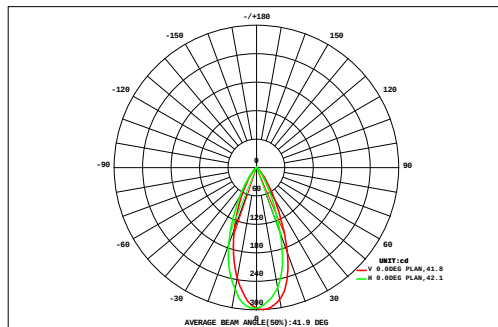

DATA OF LAMP				Eff:26.48lm/W	
MODEL				Imax(cd)	299.3
NOMINAL POWER(W)	6.432	AVAILABILITY(%)	87.7		
RATED VOLTAGE(V)	48	Avai. FLUX(lm)	149.3		
NOMINAL FLUX(lm)	170.3	LOR(%)	100.0		
LAMPS INSIDE	1	TOTAL FLUX(lm)	170.3		
TEST VOLTAGE(V)	48	q @50%(H,V)	42,42DEG		

AREA FLUX DIAGRAM																		UNIT:lm	F t	F a
72	0.01	0.01	0.01	0.01	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.02	0.02	0.02	0.01	0.01	0.01	0.00	0.29	0.00
64	0.01	0.01	0.01	0.02	0.02	0.03	0.03	0.03	0.04	0.04	0.04	0.03	0.03	0.02	0.02	0.01	0.01	0.00	0.40	0.00
56	0.01	0.01	0.02	0.02	0.03	0.04	0.05	0.06	0.07	0.08	0.07	0.06	0.04	0.03	0.02	0.02	0.01	0.00	0.64	0.00
48	0.01	0.01	0.02	0.03	0.04	0.07	0.11	0.15	0.18	0.18	0.16	0.13	0.09	0.05	0.03	0.02	0.01	0.00	1.31	0.00
40	0.01	0.01	0.02	0.04	0.08	0.15	0.26	0.37	0.45	0.46	0.40	0.30	0.18	0.10	0.05	0.02	0.01	0.00	2.93	0.29
32	0.01	0.02	0.03	0.06	0.14	0.31	0.56	0.88	1.15	1.21	0.99	0.65	0.38	0.18	0.08	0.03	0.01	0.00	6.67	5.07
24	0.01	0.02	0.03	0.09	0.23	0.55	1.13	1.90	2.65	2.84	2.31	1.40	0.68	0.31	0.11	0.03	0.01	0.00	14.3	13.2
	0.01	0.02	0.04	0.12	0.34	0.87	1.86	3.20	4.33	4.58	3.86	2.41	1.13	0.45	0.15	0.04	0.01	0.00	23.4	22.5
	0.01	0.02	0.04	0.14	0.43	1.12	2.40	4.02	5.25	5.53	4.85	3.23	1.52	0.57	0.18	0.04	0.01	0.00	29.4	28.6
	0.01	0.02	0.04	0.14	0.44	1.16	2.50	4.12	5.35	5.65	4.97	3.33	1.58	0.59	0.19	0.04	0.01	0.00	30.1	29.4
	0.01	0.01	0.03	0.11	0.37	0.98	2.12	3.54	4.55	4.80	4.12	2.68	1.29	0.50	0.15	0.03	0.01	0.00	25.3	24.5
-24	0.01	0.01	0.02	0.08	0.26	0.67	1.44	2.42	3.17	3.29	2.68	1.70	0.86	0.35	0.10	0.02	0.00	0.00	17.1	16.2
-32	0.01	0.01	0.02	0.04	0.14	0.38	0.77	1.28	1.66	1.70	1.36	0.88	0.47	0.19	0.06	0.01	0.00	0.00	8.98	7.84
-40	0.00	0.01	0.01	0.02	0.06	0.15	0.33	0.53	0.69	0.70	0.57	0.38	0.20	0.08	0.03	0.01	0.00	0.00	3.77	1.70
-48	0.00	0.00	0.00	0.01	0.02	0.05	0.09	0.16	0.21	0.22	0.18	0.12	0.06	0.03	0.01	0.00	0.00	0.00	1.17	0.00
-56	0.00	0.00	0.00	0.00	0.01	0.01	0.02	0.04	0.05	0.05	0.04	0.03	0.02	0.01	0.00	0.00	0.00	0.00	0.30	0.00
-64	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.00	0.09	0.00
-72	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.06	0.00
	-72	-64	-56	-48	-40	-32	-24	-16	HORIZONTAL(DEG)	16	24	32	40	48	56	64	72			
F t	0.11	0.19	0.36	0.92	2.63	6.57	13.7	22.8	29.8	31.4	26.6	17.4	8.56	3.51	1.21	0.36	0.11	0.05	166	---
F a	0.00	0.00	0.00	0.00	0.58	5.14	12.5	21.6	28.7	30.2	25.5	16.2	7.23	1.58	0.00	0.00	0.00	0.00	---	149

one-half-peak spread: U:21.3,D:21.0 , L:21.9,R:20.2


NEMA Beam Type: Type 5

H_(b) Range: -90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature: 25.3DEG
Operators: Fan
Test Date: 2023-07-31

V(B) Range: -180 - 180DEG
V(B) Interval: 0.5DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity: 65.0%
Test Distance: 8.630m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

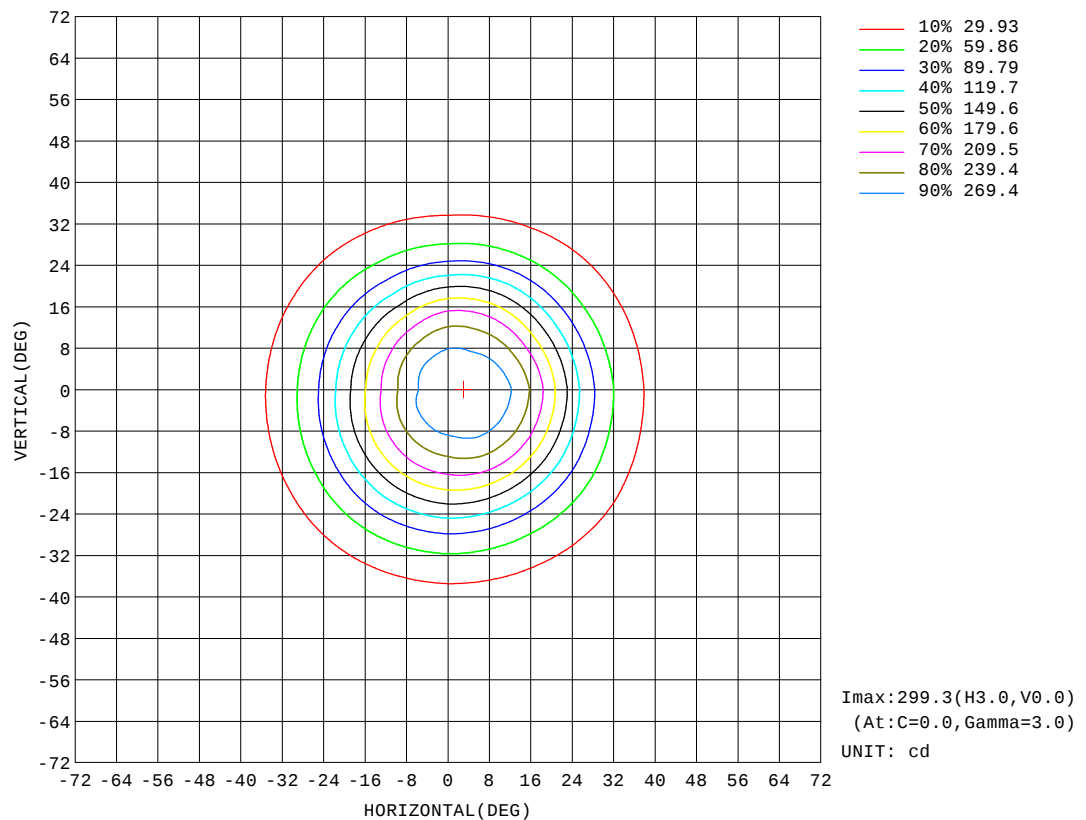


H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-07-31

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

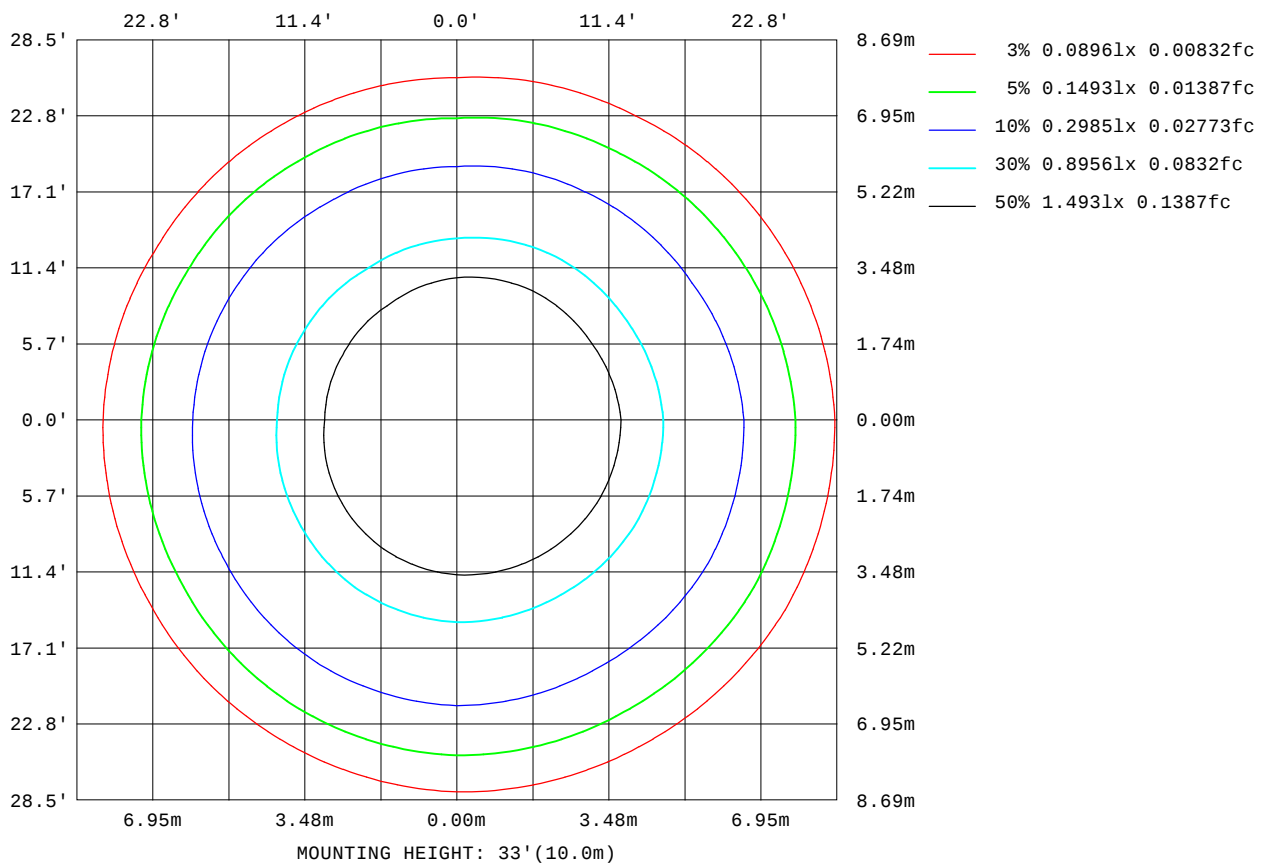

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-07-31

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

Planar Illuminance Curve

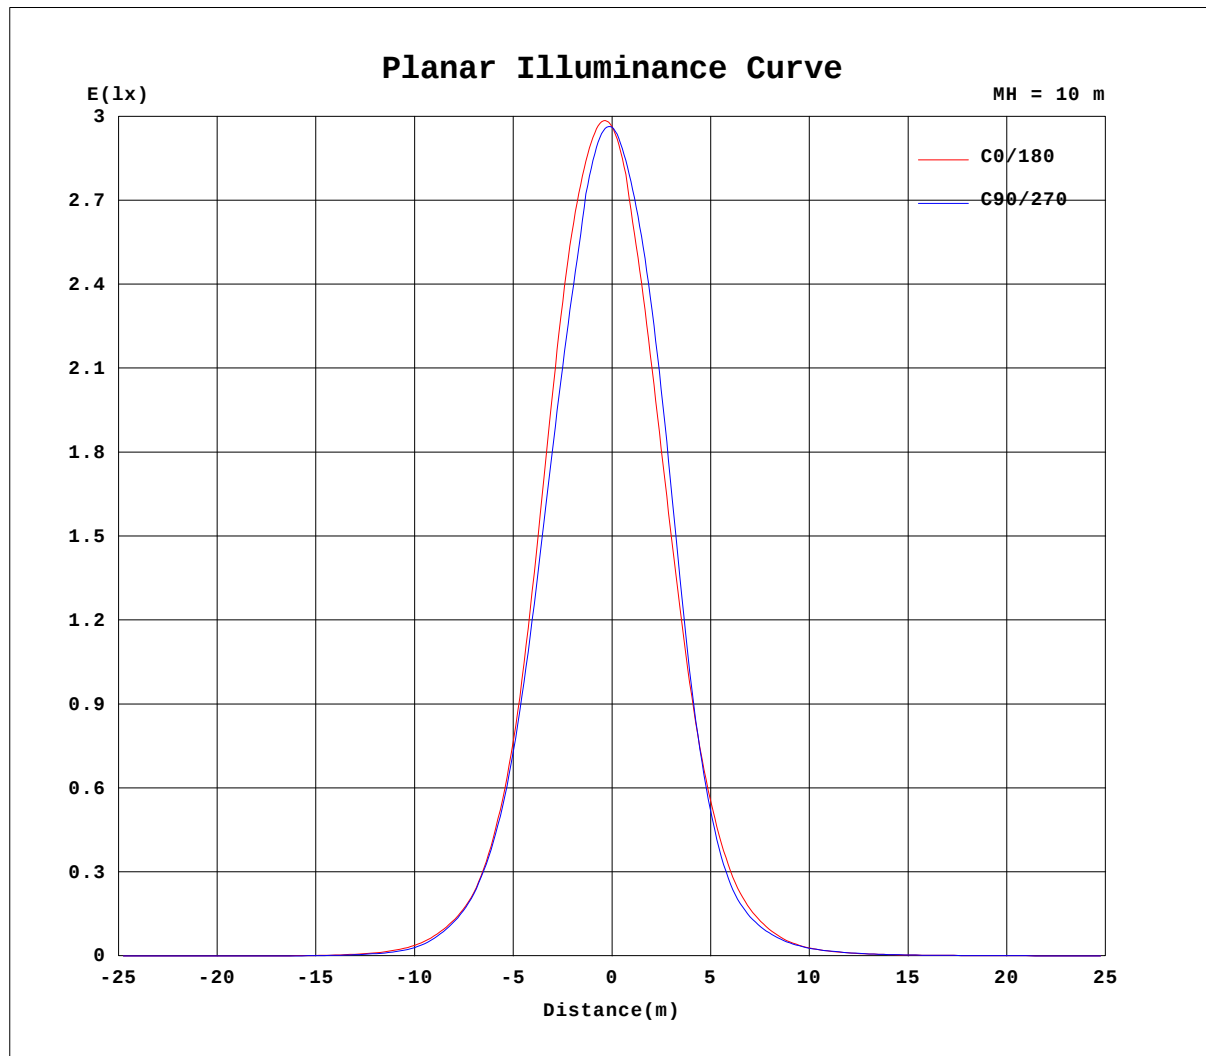


H_(b) Range: -90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature: 25.3DEG
Operators: Fan
Test Date: 2023-07-31

V(B) Range: -180 - 180DEG
V(B) Interval: 0.5DEG
Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity: 65.0%
Test Distance: 8.630m [K=1.0000]
Remarks:

AAI CURVES

NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

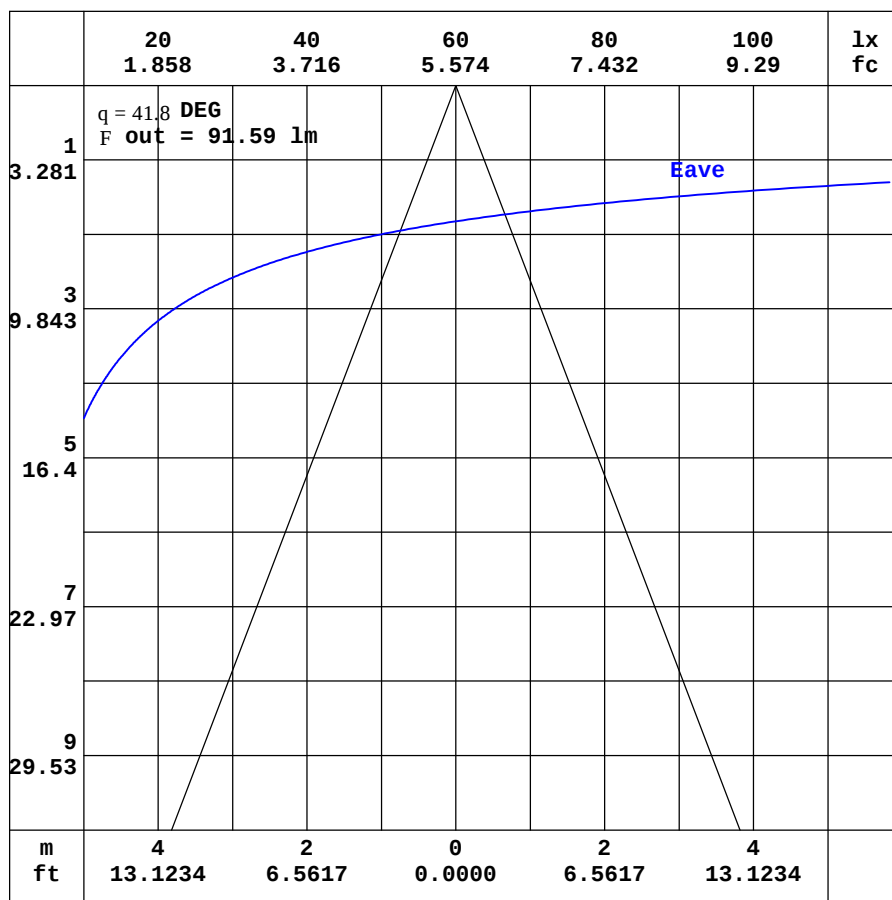

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-07-31

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE G0-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-180	0.49	0.45	0.45	0.46	0.48	0.55	0.66	0.79	0.94	1.09	1.22	1.31	1.36	1.36	1.35	1.28	1.24	1.21	1.23
-170	0.49	0.44	0.43	0.43	0.44	0.49	0.55	0.64	0.73	0.82	0.90	0.95	0.98	0.97	0.96	0.96	1.01	1.02	1.09
-160	0.49	0.43	0.41	0.40	0.40	0.42	0.45	0.48	0.52	0.54	0.56	0.57	0.57	0.67	0.75	0.81	0.86	0.91	0.94
-150	0.49	0.42	0.40	0.38	0.36	0.35	0.35	0.34	0.33	0.30	0.27	0.34	0.40	0.47	0.53	0.59	0.64	0.68	0.71
-140	0.49	0.42	0.39	0.36	0.33	0.30	0.28	0.24	0.20	0.18	0.20	0.22	0.25	0.28	0.31	0.35	0.39	0.42	0.43
-130	0.49	0.42	0.37	0.34	0.30	0.27	0.23	0.19	0.17	0.17	0.16	0.17	0.16	0.16	0.17	0.20	0.21	0.23	0.24
-120	0.49	0.42	0.37	0.32	0.28	0.24	0.20	0.17	0.16	0.16	0.16	0.16	0.15	0.15	0.16	0.16	0.17	0.17	0.17
-110	0.49	0.43	0.36	0.31	0.27	0.23	0.18	0.17	0.16	0.16	0.16	0.16	0.15	0.15	0.16	0.16	0.16	0.16	0.17
-100	0.49	0.43	0.38	0.32	0.26	0.22	0.17	0.16	0.16	0.16	0.16	0.16	0.15	0.15	0.16	0.16	0.16	0.16	0.17
-90	0.49	0.43	0.38	0.32	0.27	0.22	0.16	0.16	0.16	0.16	0.16	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
-80	0.49	0.44	0.39	0.33	0.28	0.22	0.15	0.15	0.15	0.16	0.16	0.17	0.18	0.17	0.17	0.17	0.16	0.16	0.15
-70	0.49	0.45	0.41	0.38	0.33	0.26	0.17	0.15	0.16	0.17	0.19	0.21	0.22	0.22	0.22	0.21	0.21	0.21	0.20
-60	0.49	0.46	0.45	0.43	0.39	0.32	0.25	0.19	0.21	0.23	0.26	0.29	0.32	0.34	0.36	0.36	0.38	0.40	0.40
-50	0.49	0.48	0.50	0.49	0.47	0.44	0.38	0.29	0.27	0.32	0.38	0.56	0.85	1.27	1.80	2.36	2.85	3.23	3.42
-40	0.49	0.50	0.54	0.57	0.59	0.60	0.58	0.53	0.45	0.67	1.32	2.44	3.90	6.12	9.25	13.3	17.2	20.1	21.5
-30	0.49	0.52	0.60	0.66	0.73	0.80	0.85	0.90	1.20	2.14	3.83	7.50	14.4	23.5	33.9	46.8	58.7	67.8	72.1
-20	0.49	0.55	0.64	0.75	0.88	1.03	1.19	1.48	2.44	4.47	8.91	18.2	30.8	51.1	77.7	108	139	161	173
-10	0.49	0.57	0.69	0.85	1.03	1.26	1.55	2.12	3.74	6.97	14.5	27.4	48.3	80.4	123	172	215	246	261
0	0.49	0.58	0.73	0.92	1.16	1.47	1.87	2.62	4.56	8.23	16.6	30.7	54.2	89.6	137	189	236	274	296
10	0.49	0.58	0.73	0.91	1.14	1.44	1.82	2.46	4.12	7.28	13.8	25.4	43.4	72.4	110	157	202	237	256
20	0.49	0.57	0.71	0.89	1.10	1.37	1.69	2.14	3.16	5.38	9.07	15.9	26.0	40.3	60.6	84.0	109	133	147
30	0.49	0.56	0.70	0.84	1.03	1.25	1.51	1.83	2.31	3.31	5.27	8.02	12.3	18.3	24.9	31.8	38.5	44.1	46.5
40	0.49	0.55	0.66	0.79	0.94	1.11	1.31	1.54	1.80	2.13	2.75	3.85	5.35	6.99	8.96	11.0	12.9	14.2	14.7
50	0.49	0.54	0.64	0.73	0.84	0.97	1.11	1.26	1.42	1.59	1.79	1.99	2.30	2.71	3.22	3.77	4.26	4.58	4.71
60	0.49	0.52	0.59	0.67	0.74	0.83	0.92	1.01	1.10	1.19	1.29	1.38	1.47	1.56	1.66	1.75	1.82	1.87	1.89
70	0.49	0.52	0.55	0.60	0.66	0.71	0.76	0.80	0.84	0.88	0.92	0.96	1.00	1.04	1.09	1.13	1.16	1.18	1.20
80	0.49	0.51	0.53	0.54	0.56	0.59	0.62	0.63	0.65	0.66	0.67	0.68	0.68	0.70	0.72	0.74	0.75	0.77	0.78
90	0.49	0.49	0.50	0.51	0.52	0.53	0.54	0.53	0.52	0.51	0.51	0.50	0.49	0.50	0.51	0.52	0.53	0.54	0.55
100	0.49	0.49	0.49	0.49	0.48	0.48	0.49	0.48	0.47	0.46	0.46	0.45	0.45	0.45	0.46	0.46	0.46	0.47	0.47
110	0.49	0.49	0.47	0.46	0.46	0.46	0.46	0.46	0.45	0.45	0.45	0.45	0.45	0.46	0.47	0.46	0.46	0.46	0.45
120	0.49	0.47	0.46	0.46	0.45	0.45	0.45	0.45	0.45	0.46	0.49	0.52	0.54	0.57	0.58	0.59	0.59	0.58	0.57
130	0.49	0.46	0.45	0.45	0.45	0.45	0.45	0.46	0.49	0.55	0.61	0.67	0.73	0.78	0.82	0.84	0.85	0.86	0.85
140	0.49	0.46	0.45	0.45	0.45	0.46	0.48	0.53	0.60	0.68	0.78	0.87	0.95	1.04	1.10	1.13	1.16	1.16	1.15
150	0.49	0.45	0.45	0.45	0.46	0.48	0.54	0.62	0.72	0.83	0.94	1.05	1.16	1.24	1.32	1.37	1.38	1.38	1.37
160	0.49	0.45	0.45	0.45	0.47	0.51	0.59	0.70	0.83	0.96	1.08	1.20	1.28	1.35	1.38	1.40	1.40	1.40	1.42
170	0.49	0.45	0.45	0.45	0.47	0.54	0.64	0.76	0.91	1.05	1.18	1.28	1.35	1.36	1.36	1.37	1.33	1.30	1.37
180	0.49	0.45	0.45	0.46	0.48	0.55	0.66	0.79	0.94	1.09	1.22	1.31	1.36	1.36	1.35	1.28	1.24	1.21	1.27

H_(b) Range: -90 - 90DEGH_(b) Interval: 0.5DEG

Test Speed: LOW

Temperature: 25.3DEG

Operators: Fan

Test Date: 2023-07-31

V(B) Range: -180 - 180DEG

V(B) Interval: 0.5DEG

Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351

Humidity: 65.0%

Test Distance: 8.630m [K=1.0000]

Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:Astra D88-88mm-RGBW 6500K-40D-Rev2	TYPE:RGBW-6500K	WEIGHT:
SPEC.:40 DEG	DIA.:88MM	SERIAL No.:IES001379
MFR.:	SUR.:	Shielding Angle:

Table--2

UNIT: cd

H(°) \ V(°)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90
-180	1.09	1.00	0.92	0.84	0.71	0.58	0.45	0.34	0.24	0.19	0.15	0.15	0.15	0.15	0.15	0.14	0.13	0.13
-170	1.00	0.96	0.91	0.82	0.70	0.58	0.45	0.33	0.24	0.19	0.16	0.15	0.15	0.15	0.15	0.14	0.13	0.13
-160	0.89	0.83	0.76	0.69	0.60	0.49	0.39	0.30	0.23	0.18	0.16	0.16	0.16	0.15	0.15	0.14	0.13	0.13
-150	0.67	0.61	0.55	0.48	0.42	0.35	0.29	0.24	0.20	0.17	0.16	0.16	0.16	0.16	0.15	0.14	0.13	0.13
-140	0.40	0.37	0.33	0.28	0.24	0.22	0.20	0.18	0.18	0.17	0.17	0.16	0.16	0.16	0.15	0.14	0.13	0.13
-130	0.23	0.21	0.18	0.16	0.15	0.16	0.16	0.16	0.17	0.17	0.17	0.17	0.16	0.16	0.15	0.14	0.13	0.13
-120	0.17	0.17	0.16	0.15	0.15	0.15	0.16	0.16	0.16	0.17	0.17	0.17	0.16	0.16	0.15	0.14	0.13	0.13
-110	0.16	0.16	0.16	0.15	0.15	0.15	0.15	0.16	0.16	0.17	0.17	0.17	0.16	0.16	0.15	0.14	0.13	0.13
-100	0.16	0.16	0.16	0.15	0.15	0.15	0.15	0.16	0.16	0.16	0.17	0.17	0.16	0.15	0.14	0.14	0.13	0.13
-90	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.14	0.14	0.14	0.14	0.14	0.13	0.13	0.13	0.13	0.13	0.13
-80	0.16	0.16	0.16	0.16	0.17	0.17	0.16	0.15	0.15	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.13
-70	0.20	0.20	0.21	0.20	0.20	0.20	0.18	0.17	0.16	0.15	0.14	0.14	0.14	0.14	0.14	0.14	0.14	0.13
-60	0.40	0.38	0.36	0.34	0.31	0.29	0.26	0.23	0.21	0.17	0.15	0.15	0.15	0.15	0.14	0.14	0.14	0.13
-50	3.37	3.12	2.70	2.16	1.59	1.09	0.70	0.42	0.29	0.24	0.20	0.18	0.16	0.16	0.15	0.14	0.14	0.13
-40	20.8	18.7	15.3	11.4	7.88	5.10	3.29	1.93	0.95	0.43	0.28	0.23	0.19	0.17	0.16	0.15	0.14	0.13
-30	69.5	61.5	50.2	38.3	28.3	18.9	10.6	5.51	2.91	1.26	0.48	0.30	0.23	0.19	0.17	0.15	0.14	0.13
-20	169	152	123	91.9	63.2	40.4	24.6	12.7	5.79	2.70	0.97	0.36	0.27	0.21	0.18	0.16	0.14	0.13
-10	265	247	211	159	105	64.3	36.4	20.3	9.25	4.00	1.51	0.47	0.30	0.23	0.19	0.16	0.14	0.13
0	298	282	247	190	124	75.4	41.3	23.1	10.9	4.62	1.78	0.55	0.32	0.24	0.19	0.17	0.14	0.13
10	252	235	197	146	95.2	56.9	33.2	19.2	9.45	4.48	1.86	0.77	0.51	0.36	0.27	0.20	0.16	0.13
20	146	131	104	75.1	49.1	32.4	21.2	12.2	6.74	3.55	1.67	0.94	0.66	0.46	0.33	0.24	0.17	0.13
30	46.4	41.9	35.3	28.5	22.0	15.7	10.6	7.04	4.36	2.43	1.49	1.06	0.75	0.53	0.37	0.26	0.19	0.13
40	14.7	13.8	12.2	10.2	8.32	6.52	4.96	3.44	2.51	1.92	1.45	1.07	0.79	0.57	0.40	0.28	0.20	0.13
50	4.73	4.56	4.20	3.72	3.16	2.65	2.24	1.97	1.76	1.57	1.33	1.02	0.77	0.57	0.42	0.29	0.20	0.13
60	1.90	1.88	1.83	1.77	1.69	1.60	1.50	1.41	1.31	1.21	1.11	0.92	0.72	0.55	0.41	0.30	0.21	0.13
70	1.20	1.19	1.17	1.14	1.11	1.07	1.04	1.00	0.96	0.92	0.87	0.79	0.64	0.51	0.40	0.30	0.21	0.13
80	0.78	0.77	0.76	0.75	0.74	0.73	0.72	0.72	0.70	0.70	0.69	0.67	0.56	0.46	0.37	0.29	0.21	0.13
90	0.54	0.54	0.53	0.53	0.52	0.51	0.52	0.53	0.54	0.55	0.56	0.57	0.50	0.43	0.35	0.28	0.20	0.13
100	0.47	0.46	0.46	0.46	0.45	0.45	0.46	0.46	0.47	0.49	0.50	0.51	0.45	0.39	0.33	0.27	0.20	0.13
110	0.45	0.46	0.46	0.46	0.46	0.46	0.45	0.45	0.45	0.46	0.46	0.46	0.41	0.36	0.31	0.26	0.20	0.13
120	0.58	0.58	0.57	0.56	0.55	0.52	0.49	0.47	0.46	0.46	0.46	0.42	0.38	0.34	0.29	0.24	0.19	0.13
130	0.85	0.83	0.81	0.78	0.74	0.68	0.62	0.57	0.51	0.47	0.44	0.39	0.35	0.31	0.27	0.23	0.18	0.13
140	1.15	1.13	1.10	1.05	0.97	0.89	0.80	0.71	0.62	0.53	0.42	0.36	0.32	0.28	0.25	0.21	0.17	0.13
150	1.38	1.37	1.34	1.28	1.19	1.09	0.98	0.86	0.67	0.52	0.41	0.33	0.28	0.25	0.23	0.19	0.16	0.13
160	1.41	1.41	1.40	1.38	1.32	1.22	1.02	0.81	0.62	0.46	0.36	0.28	0.24	0.22	0.20	0.18	0.15	0.13
170	1.31	1.37	1.38	1.29	1.14	0.97	0.79	0.61	0.46	0.34	0.26	0.23	0.20	0.19	0.18	0.16	0.14	0.13
180	1.09	1.00	0.92	0.84	0.71	0.58	0.45	0.34	0.24	0.19	0.15	0.15	0.15	0.15	0.15	0.14	0.13	0.13

H_(b) Range: -90 - 90DEGH_(b) Interval: 0.5DEG

Test Speed: LOW

Temperature: 25.3DEG

Operators: Fan

Test Date: 2023-07-31

V(B) Range: -180 - 180DEG

V(B) Interval: 0.5DEG

Test System: EVERFINE G0-2000B_V1 SYSTEM V2.0.351

Humidity: 65.0%

Test Distance: 8.630m [K=1.0000]

Remarks: