

Floodlight Summary:

Report based on lamp delivering 1000 lumens.


Maximum Intensity		4204.1 cd per klm.
(Luminaire orientation as tested.)		0.0 degrees vertical
		0.0 degrees horizontal
Beam Spread	At 10% of Imax	49.4V x 51.2H
	At 50% of Imax	19.4V x 22.9H
	At 90% of Imax	6.8V x 8.6H
Beam Flux	Total	1000.5 lumens per klm.
	To 10% of Imax	780.4 lumens per klm.
	To 50% of Imax	316.3 lumens per klm.
	To 90% of Imax	54.4 lumens per klm.
	Upward LOR	1.6 %
	Downward LOR	98.4 %
Luminaire Efficiency(Light Output Ratio)		100.0 %

H(θ) Range:-90 - 90DEG
H(θ) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-03-13

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

LUMINAIRE PHOTOMETRIC TEST REPORT

NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

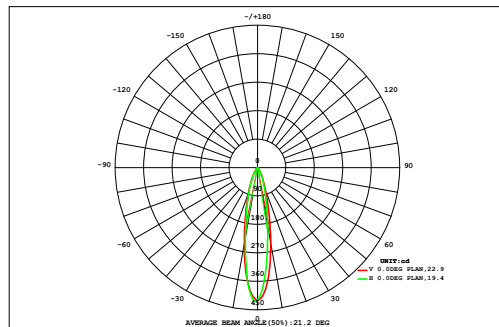

DATA OF LAMP		Eff:14.67lm/W	
MODEL		Imax (cd)	421.7
NOMINAL POWER (W)	6.84	AVAILABILITY (%)	78.1
RATED VOLTAGE (V)	24	Avai. FLUX (lm)	78.31
NOMINAL FLUX (lm)	100.3	LOR (%)	100.0
LAMPS INSIDE	1	TOTAL FLUX (lm)	100.3
TEST VOLTAGE (V)	24	q @50% (H,V)	23,19DEG

45 40 35 30 25 20 15 10 5 0 -5 -10 -15 -20 -25 -30 -35 -40 -45 -45	AREA FLUX DIAGRAM																UNIT:lm				F t	F a
	0.01	0.01	0.01	0.01	0.02	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.01	0.01	0.01	0.36	0.00		
	0.01	0.01	0.02	0.03	0.04	0.05	0.06	0.07	0.07	0.07	0.07	0.06	0.05	0.04	0.03	0.02	0.01	0.01	0.69	0.00		
	0.01	0.01	0.03	0.04	0.07	0.09	0.11	0.12	0.12	0.12	0.12	0.10	0.09	0.06	0.04	0.03	0.02	0.01	1.20	0.00		
	0.01	0.02	0.04	0.07	0.11	0.15	0.18	0.21	0.22	0.21	0.20	0.17	0.13	0.10	0.07	0.04	0.02	0.01	1.97	0.00		
	0.01	0.03	0.06	0.11	0.16	0.23	0.29	0.34	0.37	0.36	0.32	0.26	0.20	0.14	0.09	0.06	0.03	0.02	3.10	1.15		
	0.02	0.04	0.08	0.15	0.23	0.34	0.45	0.56	0.62	0.60	0.52	0.40	0.29	0.19	0.13	0.07	0.04	0.02	4.75	3.49		
	0.02	0.05	0.10	0.19	0.31	0.48	0.70	0.93	1.07	1.04	0.85	0.60	0.40	0.25	0.16	0.09	0.05	0.02	7.30	6.29		
	0.02	0.05	0.12	0.23	0.39	0.64	1.03	1.51	1.86	1.79	1.37	0.89	0.54	0.32	0.18	0.10	0.05	0.02	11.1	10.2		
	0.02	0.06	0.13	0.25	0.45	0.77	1.33	2.12	2.77	2.69	2.01	1.24	0.68	0.37	0.20	0.10	0.05	0.02	15.3	14.5		
	0.02	0.06	0.13	0.26	0.47	0.82	1.43	2.33	2.99	2.90	2.18	1.31	0.71	0.38	0.20	0.11	0.05	0.02	16.4	15.6		
	0.02	0.06	0.13	0.25	0.44	0.76	1.25	1.82	2.18	2.08	1.60	1.03	0.60	0.34	0.19	0.10	0.05	0.02	12.9	12.1		
	0.02	0.05	0.12	0.22	0.38	0.60	0.88	1.16	1.32	1.26	1.00	0.71	0.45	0.28	0.16	0.09	0.04	0.02	8.77	7.87		
	0.01	0.04	0.10	0.18	0.29	0.43	0.58	0.72	0.79	0.75	0.62	0.46	0.32	0.21	0.13	0.07	0.04	0.01	5.76	4.69		
	0.01	0.03	0.07	0.13	0.20	0.29	0.37	0.44	0.47	0.45	0.39	0.30	0.22	0.15	0.09	0.05	0.03	0.01	3.71	2.29		
	0.01	0.02	0.04	0.08	0.13	0.18	0.23	0.26	0.27	0.26	0.23	0.19	0.14	0.10	0.06	0.03	0.02	0.01	2.25	0.15		
	0.00	0.01	0.02	0.04	0.07	0.10	0.12	0.14	0.14	0.14	0.12	0.10	0.08	0.05	0.03	0.02	0.01	0.00	1.20	0.00		
	0.00	0.00	0.01	0.01	0.03	0.04	0.05	0.06	0.05	0.05	0.05	0.04	0.03	0.02	0.01	0.01	0.00	0.00	0.47	0.00		
	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.02	0.01	0.01	0.01	0.01	0.01	0.01	0.00	0.00	0.00	0.00	0.13	0.00		
	-45	-40	-35	-30	-25	-20	-15	-10	HORIZONTAL (DEG)				10	15	20	25	30	35	40	45		
F t	0.22	0.54	1.21	2.26	3.79	6.00	9.13	12.9	15.4	14.8	11.7	7.90	4.95	3.03	1.80	1.01	0.51	0.22	97	---		
F a	0.00	0.00	0.00	0.27	2.45	4.86	8.10	11.9	14.4	13.9	10.7	6.78	3.65	1.31	0.00	0.00	0.00	0.00	---	78		

one-half-peak spread: U:9.6,D:10.0 , L:11.7,R:11.4


NEMA Beam Type: Type 4

H_b) Range:-90 - 90DEG
H_b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-03-13

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

ISOCANDELA DIAGRAM

NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

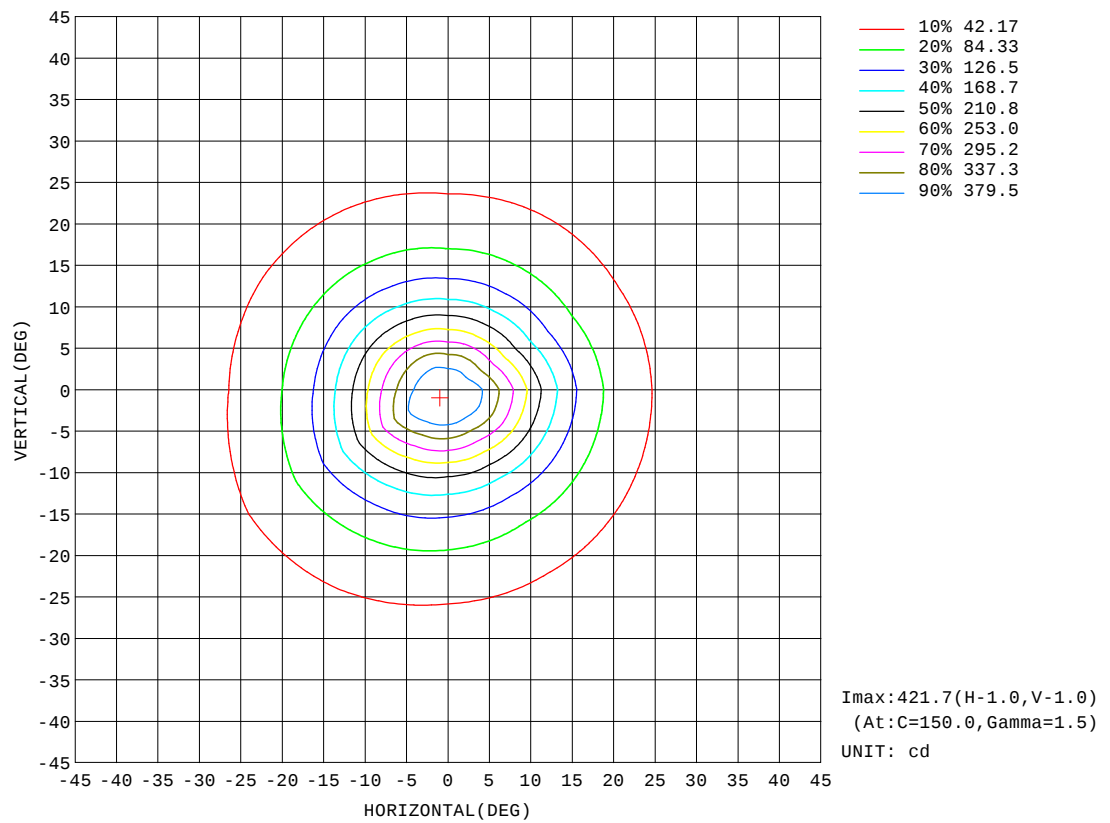


H(B) Range: -90 - 90DEG
H(B) Interval: 0.5DEG
Test Speed: LOW
Temperature: 25.3DEG
Operators: Fan
Test Date: 2023-03-13

V(B) Range: -180 - 180DEG
V(B) Interval: 0.5DEG
Test System: EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity: 65.0%
Test Distance: 8.630m [K=1.0000]
Remarks:

ISOLUX DIAGRAM


NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

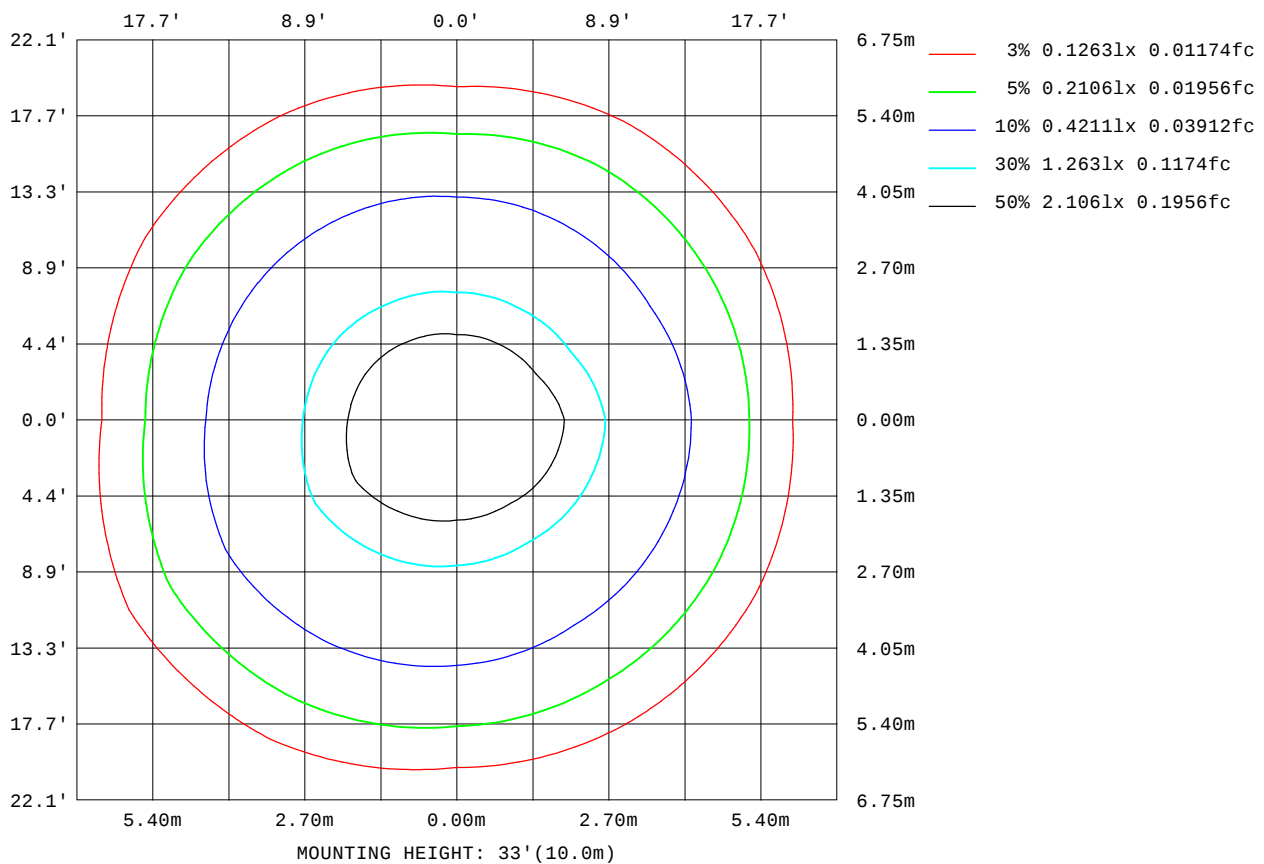

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-03-13

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

Planar Illuminance Curve

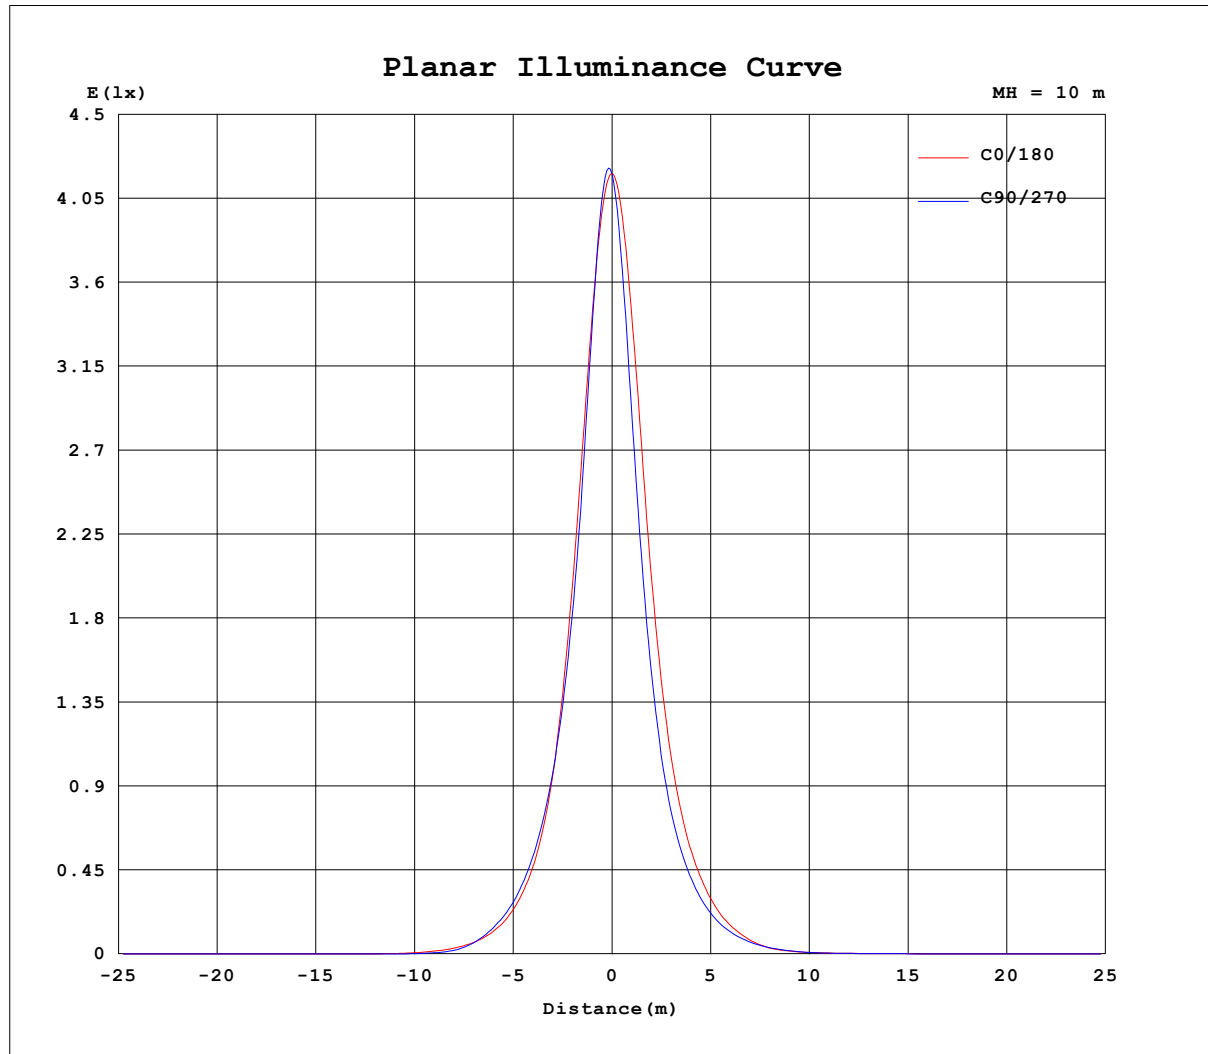


H(θ) Range:-90 - 90DEG
H(θ) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-03-13

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

AAI CURVES

NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

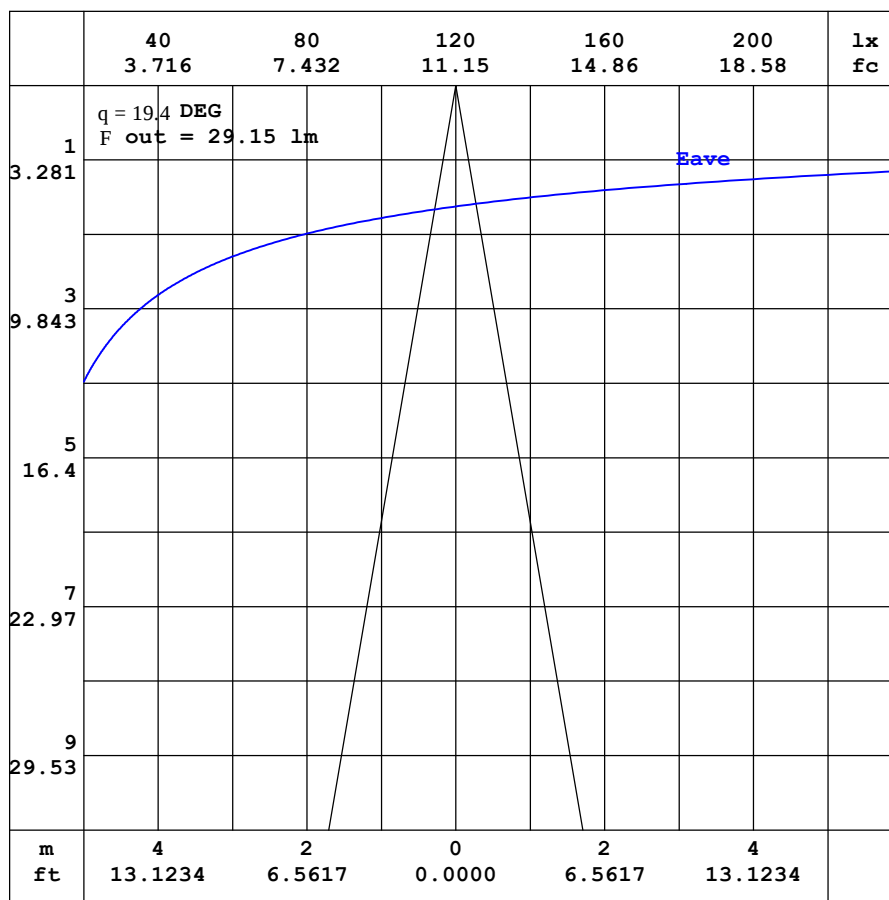

Note:The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

H_(b) Range:-90 - 90DEG
H_(b) Interval: 0.5DEG
Test Speed: LOW
Temperature:25.3DEG
Operators:Fan
Test Date:2023-03-13

V(B) Range:-180 - 180DEG
V(B) Interval: 0.5DEG
Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351
Humidity:65.0%
Test Distance:8.630m [K=1.0000]
Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

Table--1

UNIT: cd

H(°) \ V(°)	-90	-85	-80	-75	-70	-65	-60	-55	-50	-45	-40	-35	-30	-25	-20	-15	-10	-5	0
-180	0.28	0.24	0.20	0.20	0.20	0.22	0.26	0.33	0.44	0.55	0.64	0.72	0.72	0.72	0.72	0.71	0.68	0.66	0.66
-170	0.28	0.23	0.19	0.18	0.18	0.19	0.21	0.26	0.31	0.39	0.44	0.48	0.49	0.50	0.50	0.52	0.55	0.59	0.64
-160	0.28	0.23	0.19	0.17	0.16	0.16	0.17	0.18	0.20	0.21	0.23	0.23	0.23	0.30	0.36	0.41	0.46	0.51	0.55
-150	0.28	0.23	0.19	0.16	0.14	0.13	0.12	0.11	0.10	0.08	0.06	0.09	0.13	0.16	0.20	0.25	0.30	0.34	0.37
-140	0.28	0.24	0.19	0.15	0.13	0.11	0.08	0.07	0.04	0.03	0.03	0.03	0.04	0.05	0.06	0.09	0.13	0.16	0.18
-130	0.28	0.24	0.18	0.14	0.12	0.09	0.07	0.04	0.03	0.03	0.03	0.03	0.02	0.02	0.02	0.02	0.03	0.04	0.05
-120	0.28	0.23	0.18	0.15	0.11	0.09	0.05	0.04	0.04	0.04	0.04	0.04	0.04	0.04	0.03	0.02	0.02	0.02	0.02
-110	0.28	0.24	0.19	0.15	0.11	0.08	0.05	0.04	0.04	0.04	0.04	0.04	0.05	0.05	0.05	0.05	0.05	0.04	0.04
-100	0.28	0.24	0.20	0.15	0.12	0.08	0.05	0.04	0.03	0.03	0.02	0.02	0.02	0.02	0.03	0.04	0.04	0.05	0.05
-90	0.28	0.24	0.20	0.15	0.11	0.07	0.03	0.02	0.02	0.01	0.01	0.00	0.00	0.01	0.01	0.02	0.02	0.03	0.03
-80	0.28	0.24	0.20	0.15	0.11	0.06	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-70	0.28	0.25	0.21	0.18	0.14	0.08	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-60	0.28	0.25	0.24	0.21	0.16	0.10	0.05	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
-50	0.28	0.26	0.27	0.23	0.19	0.15	0.10	0.03	0.00	0.00	0.00	0.00	0.00	0.01	0.06	0.11	0.12	0.08	0.02
-40	0.28	0.28	0.29	0.26	0.24	0.22	0.19	0.13	0.05	0.00	0.05	0.31	0.76	1.44	2.31	3.18	3.73	3.71	3.03
-30	0.28	0.30	0.31	0.30	0.30	0.31	0.32	0.31	0.26	0.35	0.96	2.69	6.06	10.8	16.3	21.4	24.7	26.5	25.9
-20	0.28	0.31	0.34	0.34	0.37	0.42	0.49	0.55	0.68	1.29	3.47	9.15	17.9	28.5	41.1	55.7	69.3	78.4	79.1
-10	0.28	0.33	0.36	0.38	0.44	0.54	0.68	0.84	1.16	2.26	5.66	13.5	26.6	45.8	75.2	118	169	213	223
0	0.28	0.34	0.38	0.42	0.51	0.66	0.87	1.13	1.53	2.57	5.43	13.6	27.6	49.7	84.5	145	244	363	418
10	0.28	0.34	0.38	0.42	0.51	0.65	0.84	1.09	1.50	2.55	5.44	12.4	23.5	39.2	61.3	93.5	137	175	186
20	0.28	0.33	0.38	0.42	0.49	0.61	0.78	0.99	1.31	2.01	3.82	8.22	15.2	23.2	32.8	43.5	53.8	60.9	61.6
30	0.28	0.33	0.38	0.41	0.47	0.57	0.70	0.87	1.06	1.41	2.13	3.71	6.58	10.4	14.4	17.9	20.4	21.6	21.1
40	0.28	0.32	0.38	0.39	0.44	0.51	0.60	0.72	0.86	1.00	1.20	1.59	2.28	3.42	4.74	5.60	6.17	6.31	5.95
50	0.28	0.31	0.37	0.39	0.41	0.46	0.51	0.59	0.66	0.75	0.83	0.93	1.02	1.11	1.26	1.40	1.48	1.47	1.39
60	0.28	0.30	0.34	0.38	0.39	0.41	0.45	0.48	0.51	0.54	0.59	0.62	0.66	0.70	0.74	0.78	0.81	0.83	0.84
70	0.28	0.30	0.32	0.35	0.37	0.39	0.40	0.41	0.42	0.43	0.43	0.43	0.44	0.46	0.48	0.49	0.50	0.51	0.51
80	0.28	0.29	0.31	0.32	0.33	0.35	0.36	0.36	0.36	0.35	0.35	0.35	0.34	0.35	0.36	0.37	0.38	0.38	0.39
90	0.28	0.29	0.29	0.30	0.30	0.31	0.32	0.31	0.30	0.29	0.29	0.28	0.27	0.27	0.28	0.28	0.29	0.29	0.30
100	0.28	0.28	0.29	0.28	0.28	0.27	0.27	0.25	0.24	0.23	0.22	0.21	0.20	0.20	0.20	0.20	0.20	0.20	0.21
110	0.28	0.28	0.27	0.25	0.24	0.24	0.23	0.21	0.21	0.20	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.18
120	0.28	0.27	0.25	0.23	0.22	0.21	0.20	0.19	0.19	0.20	0.20	0.20	0.22	0.22	0.23	0.23	0.23	0.23	0.23
130	0.28	0.27	0.23	0.21	0.21	0.20	0.19	0.19	0.20	0.21	0.23	0.27	0.31	0.35	0.38	0.41	0.43	0.43	0.43
140	0.28	0.26	0.23	0.21	0.20	0.20	0.20	0.20	0.21	0.27	0.32	0.40	0.47	0.54	0.60	0.63	0.66	0.66	0.66
150	0.28	0.25	0.22	0.20	0.20	0.20	0.21	0.23	0.29	0.36	0.44	0.53	0.62	0.68	0.74	0.78	0.78	0.78	0.78
160	0.28	0.25	0.21	0.20	0.20	0.21	0.23	0.29	0.36	0.45	0.55	0.63	0.69	0.74	0.77	0.78	0.79	0.79	0.80
170	0.28	0.24	0.20	0.20	0.20	0.22	0.25	0.32	0.41	0.52	0.61	0.69	0.73	0.75	0.77	0.78	0.77	0.74	0.78
180	0.28	0.24	0.20	0.20	0.20	0.22	0.26	0.33	0.44	0.55	0.64	0.72	0.72	0.72	0.72	0.71	0.68	0.66	0.68

H(°) Range:-90 - 90DEG

H(°) Interval: 0.5DEG

Test Speed: LOW

Temperature:25.3DEG

Operators:Fan

Test Date:2023-03-13

V(B) Range:-180 - 180DEG

V(B) Interval: 0.5DEG

Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351

Humidity:65.0%

Test Distance:8.630m [K=1.0000]

Remarks:

LUMINOUS DISTRIBUTION INTENSITY DATA

NAME:BlazeMini Recessed-500mm-RGBW BLUE-1525D-Rev2	TYPE:RGBW-BLUE	WEIGHT:
SPEC.:15x25 DEG	DIM.:500mm	SERIAL No.:IES000901-B
MFR.:	SUR.:	Shielding Angle:

Table--2

UNIT: cd

H (DEG) V (DEG)	5	10	15	20	25	30	35	40	45	50	55	60	65	70	75	80	85	90	
-180	0.58	0.56	0.51	0.46	0.41	0.35	0.25	0.17	0.09	0.05	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.00	
-170	0.60	0.58	0.55	0.50	0.42	0.34	0.25	0.16	0.09	0.05	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.00	
-160	0.52	0.49	0.45	0.40	0.35	0.28	0.20	0.13	0.07	0.04	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.00	
-150	0.35	0.32	0.27	0.24	0.20	0.16	0.12	0.08	0.05	0.03	0.02	0.02	0.03	0.03	0.03	0.02	0.01	0.00	
-140	0.16	0.14	0.12	0.09	0.07	0.05	0.04	0.04	0.03	0.02	0.02	0.02	0.02	0.03	0.03	0.02	0.01	0.00	
-130	0.04	0.03	0.03	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.02	0.01	0.00	
-120	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.02	0.03	0.03	0.03	0.02	0.02	0.01	0.00	
-110	0.04	0.04	0.03	0.03	0.03	0.02	0.02	0.02	0.03	0.03	0.03	0.04	0.03	0.03	0.02	0.02	0.01	0.00	
-100	0.05	0.04	0.04	0.04	0.03	0.02	0.02	0.02	0.03	0.03	0.03	0.04	0.03	0.03	0.02	0.01	0.01	0.00	
-90	0.03	0.02	0.02	0.01	0.01	0.00	0.01	0.01	0.02	0.02	0.03	0.04	0.03	0.02	0.02	0.01	0.01	0.00	
-80	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.02	0.02	0.02	0.02	0.01	0.01	0.00	
-70	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.01	0.01	0.01	0.00	
-60	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.01	0.00	0.00	
-50	0.07	0.10	0.10	0.06	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-40	3.44	3.33	2.80	2.05	1.45	0.94	0.47	0.11	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-30	24.4	21.0	17.0	12.6	8.43	5.18	2.96	1.49	0.38	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-20	71.1	57.1	43.1	30.4	20.4	12.9	7.37	3.49	1.26	0.20	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
-10	193	142	91.2	55.8	33.5	19.5	10.7	5.19	1.99	0.43	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
0	363	242	136	72.9	40.2	22.0	11.5	5.40	2.06	0.41	0.02	0.00	0.00	0.00	0.00	0.00	0.00	0.00	
10	164	120	78.3	50.4	31.8	19.2	10.8	5.47	2.32	0.71	0.25	0.15	0.10	0.06	0.04	0.02	0.01	0.00	
20	57.9	48.9	38.2	28.0	19.7	13.1	7.89	4.22	1.90	0.76	0.42	0.28	0.18	0.12	0.08	0.04	0.02	0.00	
30	20.9	19.1	16.5	13.0	9.62	6.58	4.25	2.52	1.30	0.76	0.52	0.36	0.24	0.16	0.11	0.06	0.03	0.00	
40	6.19	5.97	5.42	4.58	3.47	2.39	1.62	1.16	0.94	0.75	0.55	0.40	0.28	0.20	0.13	0.08	0.04	0.00	
50	1.45	1.45	1.36	1.22	1.07	0.96	0.87	0.78	0.70	0.63	0.53	0.40	0.30	0.22	0.15	0.09	0.04	0.00	
60	0.82	0.79	0.76	0.72	0.67	0.63	0.59	0.56	0.52	0.49	0.47	0.39	0.30	0.23	0.16	0.10	0.05	0.00	
70	0.51	0.50	0.48	0.46	0.44	0.43	0.42	0.42	0.41	0.41	0.40	0.37	0.30	0.23	0.16	0.10	0.05	0.00	
80	0.38	0.37	0.36	0.35	0.34	0.34	0.34	0.35	0.35	0.35	0.35	0.34	0.28	0.22	0.16	0.10	0.05	0.00	
90	0.29	0.29	0.28	0.28	0.27	0.27	0.27	0.28	0.28	0.29	0.29	0.30	0.25	0.20	0.15	0.10	0.05	0.00	
100	0.20	0.20	0.19	0.19	0.19	0.19	0.19	0.20	0.21	0.22	0.23	0.24	0.21	0.18	0.13	0.09	0.05	0.00	
110	0.19	0.19	0.19	0.19	0.20	0.20	0.19	0.19	0.19	0.19	0.20	0.20	0.18	0.15	0.12	0.09	0.04	0.00	
120	0.24	0.24	0.24	0.24	0.24	0.23	0.21	0.20	0.19	0.19	0.19	0.18	0.15	0.13	0.10	0.08	0.04	0.00	
130	0.44	0.44	0.43	0.41	0.38	0.34	0.30	0.27	0.22	0.20	0.18	0.15	0.13	0.12	0.10	0.07	0.04	0.00	
140	0.67	0.67	0.66	0.63	0.58	0.52	0.45	0.37	0.30	0.25	0.17	0.14	0.11	0.10	0.09	0.06	0.03	0.00	
150	0.78	0.78	0.77	0.76	0.72	0.66	0.59	0.50	0.37	0.26	0.18	0.12	0.10	0.08	0.07	0.05	0.03	0.00	
160	0.80	0.79	0.79	0.78	0.76	0.72	0.60	0.47	0.33	0.23	0.15	0.10	0.08	0.06	0.06	0.04	0.02	0.00	
170	0.73	0.76	0.78	0.72	0.64	0.56	0.45	0.35	0.23	0.16	0.10	0.07	0.05	0.05	0.04	0.03	0.02	0.00	
180	0.58	0.56	0.51	0.46	0.41	0.35	0.25	0.17	0.09	0.05	0.03	0.03	0.03	0.03	0.03	0.02	0.01	0.00	

H_(b) Range:-90 - 90DEGH_(b) Interval: 0.5DEG

Test Speed: LOW

Temperature:25.3DEG

Operators:Fan

Test Date:2023-03-13

V(B) Range:-180 - 180DEG

V(B) Interval: 0.5DEG

Test System:EVERFINE GO-2000B_V1 SYSTEM V2.0.351

Humidity:65.0%

Test Distance:8.630m [K=1.0000]

Remarks: